PRODUCT SPECIFICATIONS

Elkay Cooler Wall Mount Non-Filtered Non-Refrigerated Stainless. Furnished with Flexi-Guard® Safety bubbler. Mechanical Top Bubbler Button activation. Product shall be Wall Mount (On-Wall), for Indoor applications, serving 1 station(s). Unit shall be lead-free design which is certified to NSF/ANSI 61 & 372 (lead free) and meets Federal and State low-lead requirements.

Finish:	Stainless Steel
Power:	No Electrical Required
Bubbler Style:	Flexi-Guard® Safety
Activation by:	Mechanical Top Bubbler Button
Mounting Type:	Wall Mount (On-Wall)
Chilling Option:	Non-Refrigerated
Dimensions (L x W x H):	18" x 14-1/2" x 29-1/2"
Approx. Shipping Weight:	44 lbs.
Installation Location:	Indoor
No. of Stations Served:	1

- Mechanically-Activated bubbler continues to supply water in event of service disruptions.

AMERICAN PRIDE. A LIFETIME TRADITION.
Like your family, the Elkay family has values and traditions that endure. For almost a century, Elkay has been a family-owned and operated company, providing thousands of jobs that support our families and communities.

Included with Product: Water Cooler

PRODUCT COMPLIANCE

Buy American Act

NSF/ANSI 61 & 372 (lead free)

Installation Instructions (PDF)

Water Systems are warranted for 12 months from date of installation. **Warranty pertains to drinking water applications only. Non-drinking water applications are not covered under warranty.**

Warranty (PDF)

OPTIONAL ACCESSORIES

EWF172 - WaterSentry VII Filter Kit (Coolers + Fountains)
LK1110 - Elkay Glass Filler
LK1114 - Accessory - Glass Filler
97446C - Bubbler Kit Vandal-Resistant

PART:_____QTY: _____

PROJECT:_____

CONTACT:_____

DATE:_____

NOTES:_____

APPROVAL:_____

In keeping with our policy of continuing product improvement, Elkay reserves the right to change product specifications without notice. Please visit elkay.com for the most current version of Elkay product specification sheets. This specification describes an Elkay product with design, quality, and functional benefits to the user. When making a comparison of other producers' offerings, be certain these features are not overlooked.

Elkay REV 06022018
EWDAS

2222 Camden Court
Oak Brook, IL 60523

© 2018   Page 1
EWDAS_spec.pdf

Open space rough-in design permits new installation or replacement of existing fountains and coolers with this Elkay cooler when rough-in is within the outline shown.
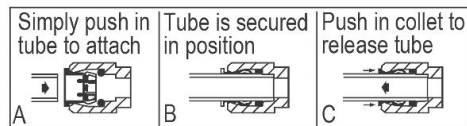
IMPORTANT! INSTALLER PLEASE NOTE:
This water cooler has been designed and built to provide water to the user which has not been altered by materials in the cooler waterways.
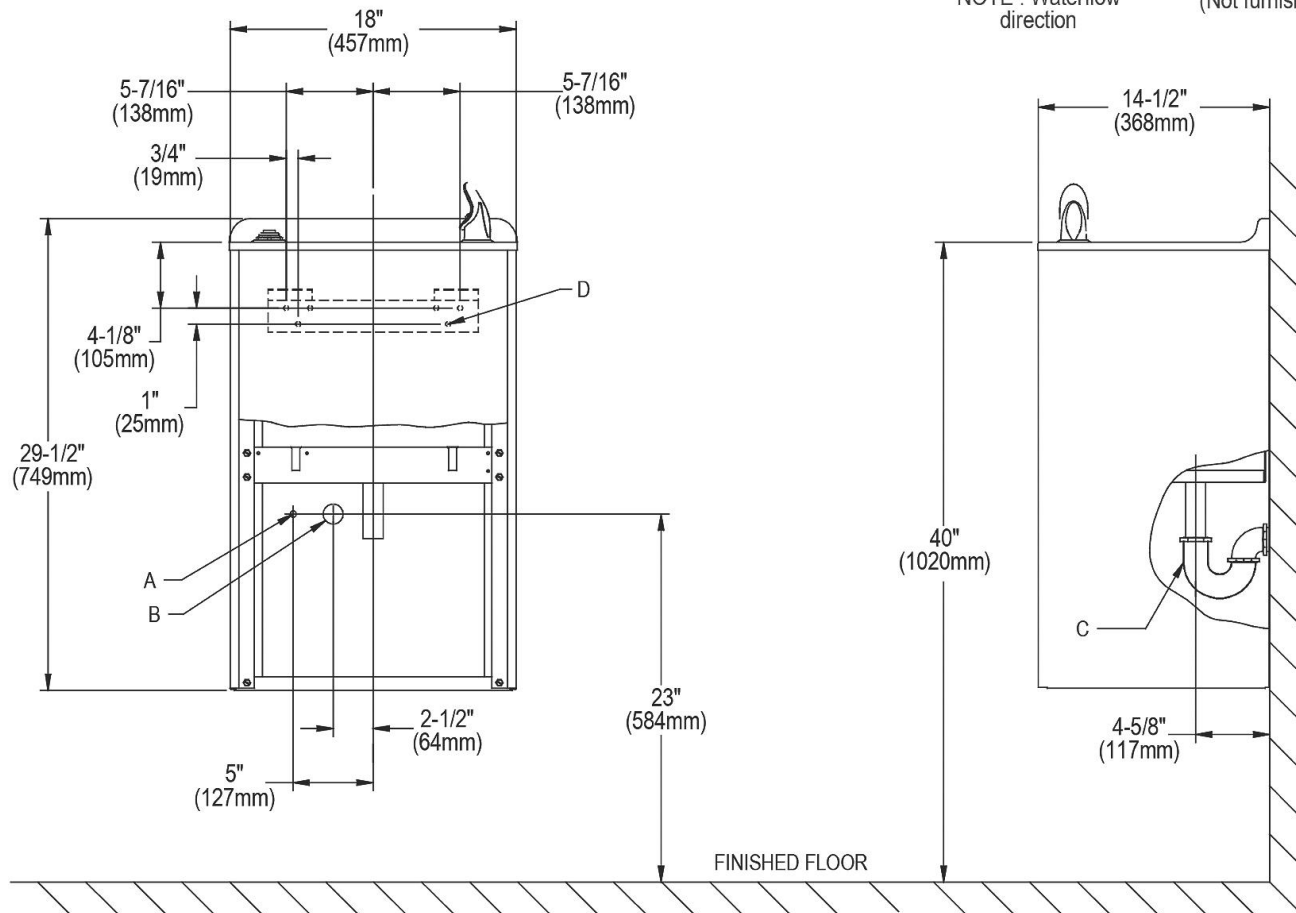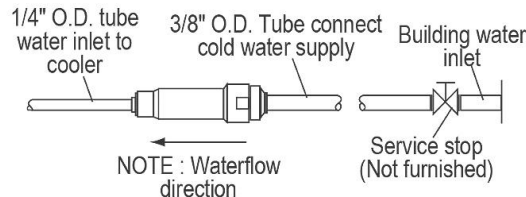
NOTICE
The water cooler must be connected to the water supply using a dielectric coupling. The cooler is furnished with a non-metallic strainer which meets this requirement. The drain trap which is provided by the installer should also be plastic to completely isolate the cooler from the building plumbing system.
These products are designed to operate on 20 psi to 105 psi supply line pressure.

OPERATION OF QUICK CONNECT FITTINGS

Simply push in tube to attach	Tube is secured in position	Push in collet to release tube
A	B	C

Pushing tube in before pulling it out helps to release tube

1/4" O.D. tube water inlet to cooler

3/8" O.D. Tube connect cold water supply

Building water inlet

NOTE : Waterflow direction

Service stop (Not furnished)

18" (457mm)

5-7/16" (138mm)

5-7/16" (138mm)

3/4" (19mm)

D

4-1/8" (105mm)

1" (25mm)

29-1/2" (749mm)

A

B

2-1/2" (64mm)

5" (127mm)

23" (584mm)

14-1/2" (368mm)

40" (1020mm)

C

4-5/8" (117mm)

FINISHED FLOOR

LEGEND
A = Recommended water supply location 3/8" O.D. unplated copper tube connect stub out 1-1/2" (38mm) out from wall shut off by others.
B = Recommended location for waste outlet 1-1/4" O.D. drain.
C = 1-1/4" Trap not furnished.
D = 5/16" (8mm) screw holes in mounting plate.
NOTE: New installations must use Ground Fault Circuit Interrupter (GFCI). It is highly recommended that the circuit be dedicated and the load protection be sized for 20 amps.

Elkay REV 06022018

EWDAS

2222 Camden Court
Oak Brook, IL 60523

© 2018   Page 2
EWDAS_spec.pdf